

## Bluff Point Wind Farm

# EMERGENCY RESPONSE PLAN

**Bluff Point Wind Farm**  
**1665 Woolnorth Rd, Woolnorth TAS 7330**

**TASMap: 3048 & 3049 1:25000 Easting 308840: Northing 5490473 (entrance)**

**Emergency Services: dial 000**

**SITE EMERGENCY CONTACT DETAILS**  
**Control Building Phone: 03 63 574 020**  
**Site Supervisor: 0428 388 370 (Adam Mullins)**  
**Wind Farm Team Leader: 0427 519 507 (Jason Jolly)**  
**Wind Farm Team Leader: 0408 242 454 (Dylan Nicholls)**


**Directions From Launceston**  
 Follow the Bass Highway (A2) to Smithton. Turn right onto Nelson Street (C215), turn left onto Davis Street (C215), over the Duck River bridge. This road turns into Montagu Road (C215) which then turns into Woolnorth Road (also the C215). From the duck river bridge in Smithton the Bluff Point Wind Farm is 40 kms to the entrance gate on the left-hand side. At this point a swipe card activated gate is installed (card reader on right hand side near gate). At the gate there is also an intercom system that allows the Site Supervisor to open the gate remotely. Once through the gate, travel 3.7 km on the gravel road to the control building and report there. The control building is on the right-hand side of the access road. The following map (Figure 1) details the route from Smithton.

Rev No:	DATE	Revision Description	Approval
0	November 2011	ORIGINAL ISSUE	Stephen Ross
1	Feb 2014	Review and update	Robert Barbour, Chris Sims, Adam Mullins
2	May 2014	Minor updates	Robert Barbour
3	Nov 2015	Review with minor updates	Chris Sims
4	July 2017	Update of contacts page	Robert Barbour
5	Dec 2020	Review & update of contacts list	Robert Barbour
6	Nov 2022	General review and update of contacts	Robert Barbour
7	Nov 2023	General review and update of contacts	Chris Sims
8	Aug 2024	Update of contacts page	Alistair Mason
9	Oct 2024	Update control building phone number	Alistair Mason

## Contents

Critical Emergency Response Steps & Info .....	3
Hand Notes .....	4
Maps.....	5
Purpose of Document .....	8
Definitions.....	8
Emergency Planning Responsibilities .....	9
Emergency Response Plan .....	9
Emergency Preparedness Planning and Practice.....	9
Bush Fire Preparedness .....	9
Fire Behaviour Index (FBI) .....	10
Site Roles and Responsibilities.....	10
Site Description .....	11
Site Communication Equipment .....	11
Site Security Systems .....	11
General Attendance Requirements .....	12
Requirements of All Workers.....	12
Wind Farm Attendance Registration System (ARS).....	12
Chemical Information .....	13
Oil and fuel.....	13
Gas.....	13
Hazardous chemicals .....	13
Site Emergency Equipment.....	14
Bluff Point Wind Farm Contacts .....	16
What to do in an Emergency .....	17
Onsite Emergencies .....	17
Identification of an Emergency.....	17
Controlling Events or Local Evacuation.....	17
Reporting an Emergency.....	17
Evacuation Procedure .....	18
Emergency Management - Incident Controller .....	18
Control Point.....	19
Wind Farm Operational Requirements.....	19
Offsite Emergencies .....	19
Potential Emergency Events at BPWF.....	20
Communication and Review .....	21
Attachment 1 – Bushfire Preparedness Checklist.....	22

# Critical Emergency Response Steps & Info

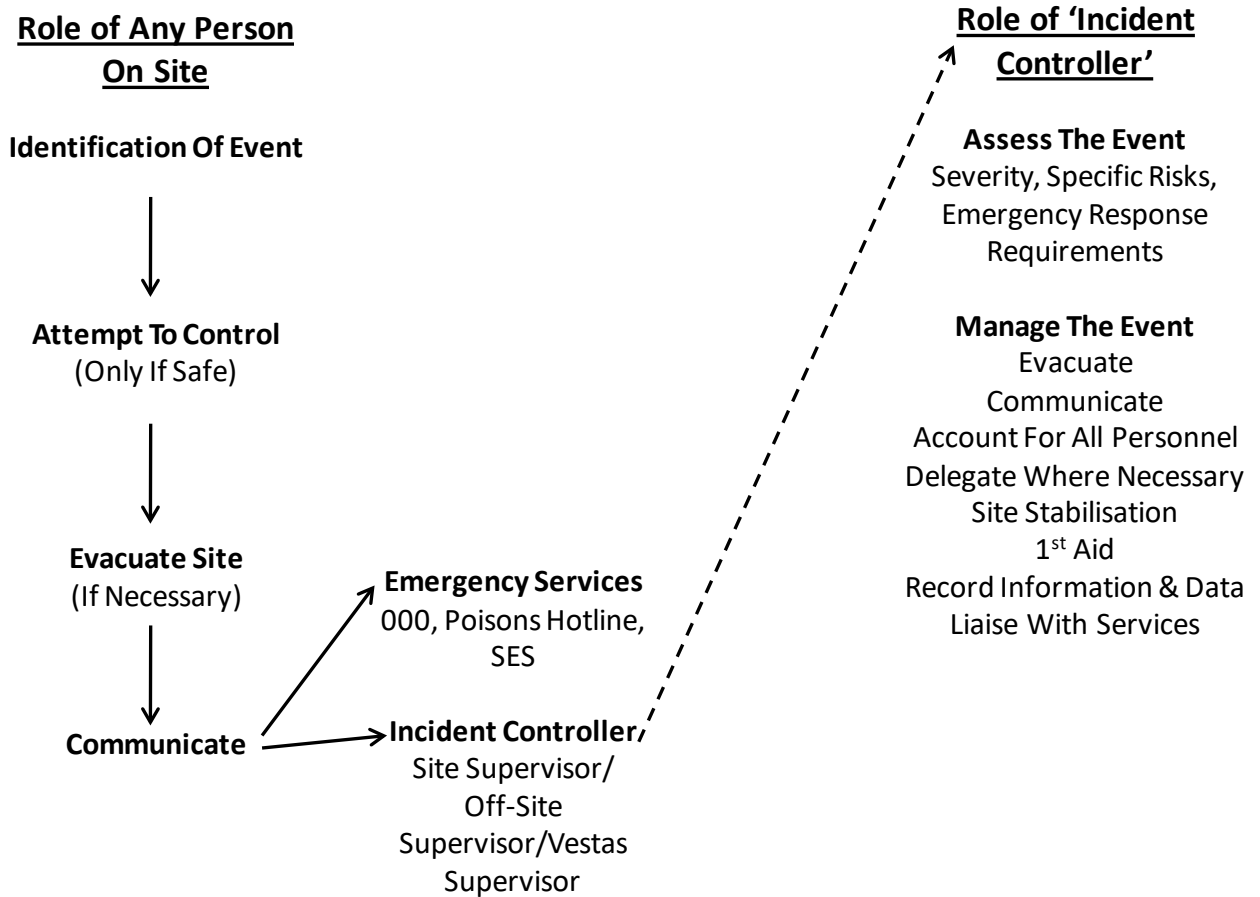

**Incident Controller** – Person with the most experience with the site conditions and emergency response planning (for all contacts see pg.15).

Primary Wind Farm Incident Controller – Site Supervisor - Adam Mullins (0428 388 370)

Secondary Wind Farm Incident Controller – Team Leader - Jason Jolly (0427 519 507)  
Dylan Nicholls (0408 242 454)

**Emergency Service contacts** – 000, 012

**Maps For Site** – pg. 5-7, Location - TASMap: Grim3049 1:25000 E308840: N 5490473

**Attendance Registration System** - electronic system in Control Building - available online (see pg.12)

**Emergency Equipment available on site** (pg.14) – First aid, defibrillation unit, dry powder & CO2 & water fire extinguishers, low voltage rescue kit, wind tower rescue kit, wind tower evacuation kit, hub rescue kit, confined space rescue kit, SF6 (sulphur hexafluoride) spill kit, chemical/oil/fuel spill kits, dead & injured bird recovering kit water points, vehicle recovery kits, emergency information tube.

**Key site details** – 44km by road from Smithton, 37 wind turbines, a 5 circuit 22kV underground electrical reticulation network, a high voltage switchyard, a 110kV transmission line (crosses the main access road) a control building containing a high voltage switch room and other services. Low volumes of oils, fuel and chemicals are held on site. The site has a 50,000L static water supply, permanent water points, helicopter landing sites, first aid and emergency response trained personnel and equipment.

## Hand Notes

Permanent marker pen is attached to the folder to take notes. This page can be pulled out as a single page holding the critical emergency response steps.




# Maps



Figure 1 – Location of Bluff Point Wind Farm and direction from Smithton

Access QR code



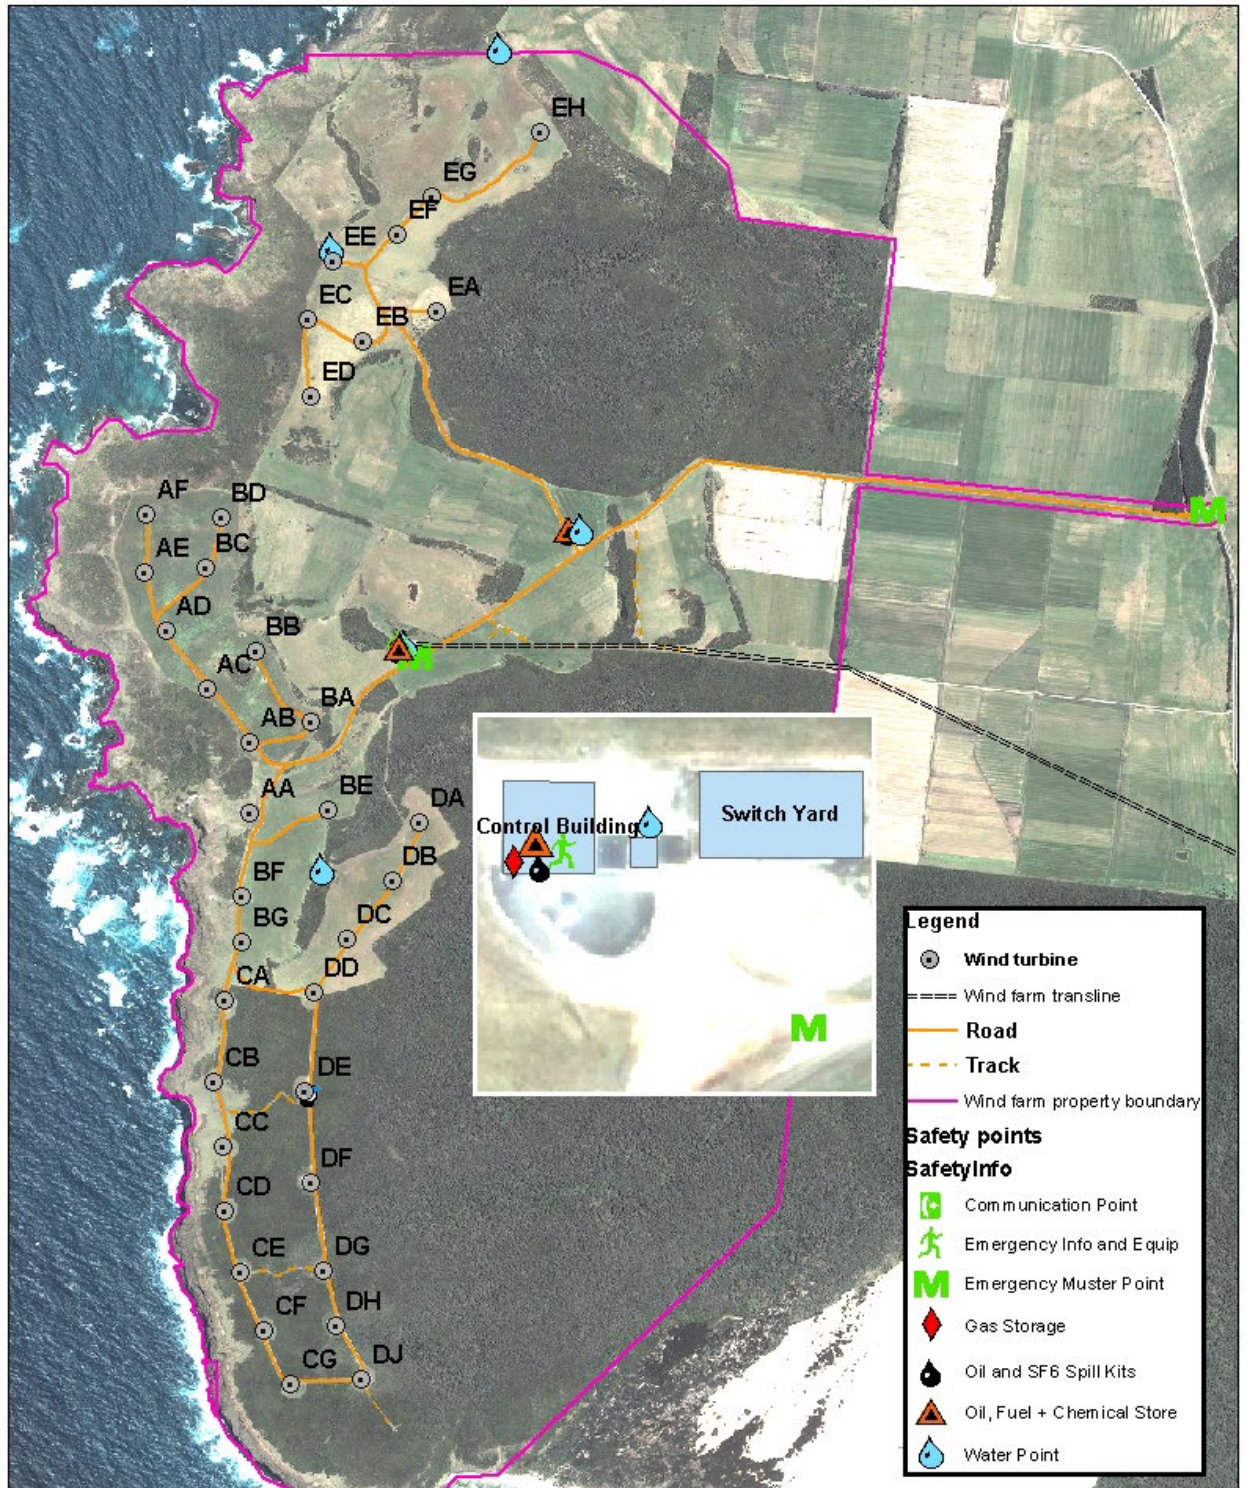

Prepared by: Robert Barbour  
 Reviewed by: Chris Sims  
 Date: 20th Nov 2015

Datum: GDA 94  
 1:25,000 when printed at A4  
 0 125 250 500 750 1,000 Meters

Woolnorth Wind Farm  
 Holding Pty Ltd

**Bluff Point Wind Farm**

Figure 2 – Bluff Point Wind Farm layout

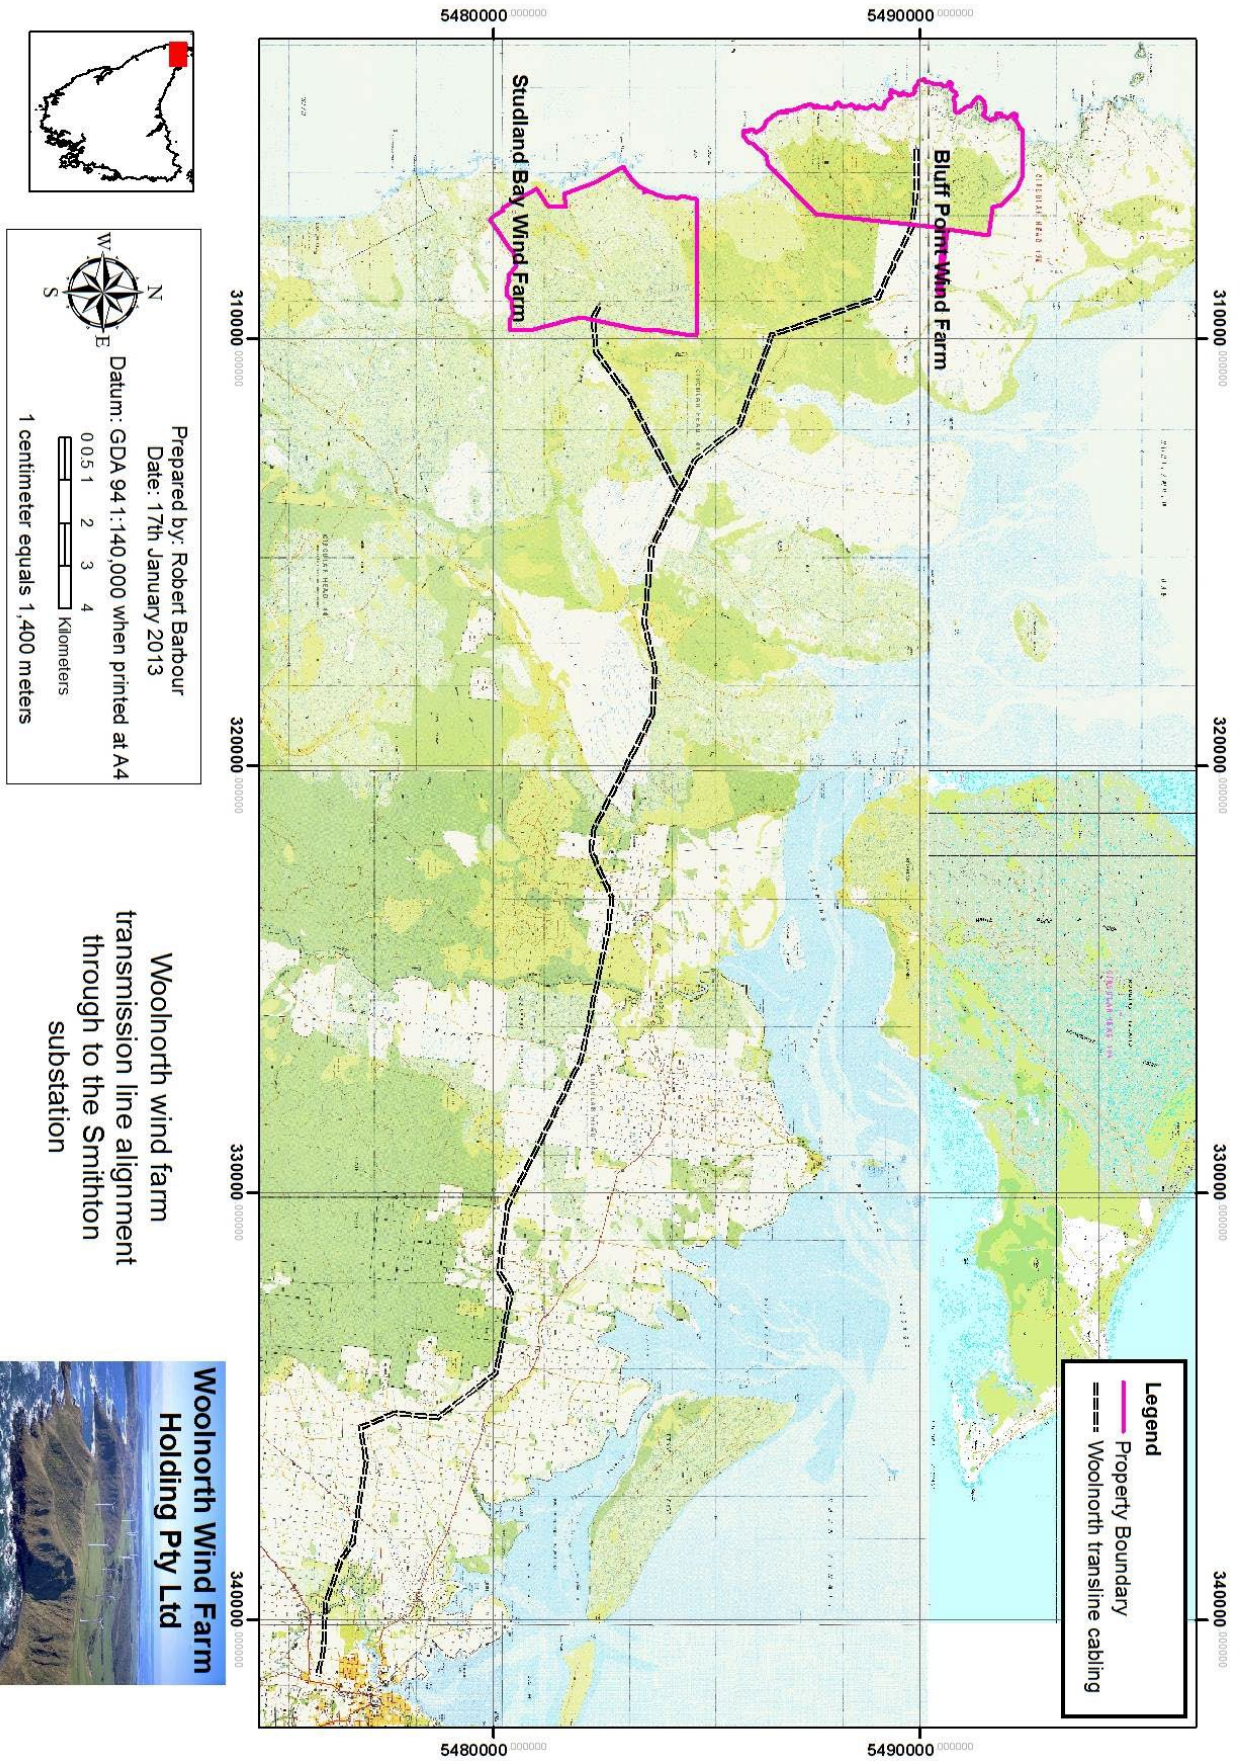


Figure 3 – Transmission line alignment from Bluff Point to the Smithton substation

## Purpose of Document

- To provide a procedure for use in the event of an emergency situation created by a fire, spill of oil or hazardous material or other major incident.
- To protect the safety of employees, contractors, farm staff, emergency service personnel and the public on this site and in any surrounding areas that may be affected.
- To protect the assets, property, and environment of Bluff Point Wind Farm and that fall under the management of Woolnorth Renewables (WNR).
- To describe WNR's approach to planning for emergency situations.

## Definitions

<b>WNR:</b>	Woolnorth Renewables (WNR)
<b>BPWF:</b>	Bluff Point Wind Farm
<b>PCBU:</b>	Person Conducting a Business or Undertaking i.e. WNR
<b>Officer:</b>	General Manager
<b>Worker:</b>	Persons engaged to carry out work or engaged by the duty holder of the PCBU
<b>Incident Controller:</b>	Person with the most experience with the site conditions and emergency response planning
<b>Emergency:</b>	An emergency can be defined as any hazardous or potentially hazardous situation where there is immediate danger to personnel, property or the environment generally. It can also be described as a situation which cannot be immediately brought under control by site Workers using available resources, where serious injury or death could be incurred, where significant property damage could occur or where serious environmental consequences could result.
<b>Emergency Services:</b>	Fire, Police, Ambulance, SES services

# Emergency Planning Responsibilities

## Emergency Response Plan

The Work, Health and Safety Regulations, 2012 (Part 3.2, Division 4, Section 43) requires a PCBU to prepare and implement emergency procedures and plans for the workplace. WNR has adopted Hydro Tasmania's Emergency Preparedness procedure HSEP1201 and this procedure details responsibility for emergency planning. The Officer (or delegate) is responsible for ensuring plans are prepared, maintained and revised, and ensuring their requirements are implemented and communicated to Workers.

Where possible the plan will be provided to relevant emergency services for review. All Workers accessing the BPWF are obligated and have a duty of care to have an understanding of this plan (commensurate with their role) and when necessary, assist in ensuring it is implemented to the greatest extent possible.

## Emergency Preparedness Planning and Practice

WNR prepares personnel for emergency situations through an annual schedule of activities including simulations, desktop and field-based emergency scenario training. WNR set this schedule (Jan-Dec inclusive) in January of each calendar year. The schedule's activities are risk focused (e.g. looks at practical likelihood and consequence) but also attempts to prepare personnel for a wide range of emergency situations. The emergency preparedness sessions are documented, and actions created to rectify any deficiencies or issues identified.

All permanent Workers on site are Level 2 (Provide First Aid) first aid trained.

## Bush Fire Preparedness

The wind farm and transmission line will be subject to impacts from fire, wildfire or controlled burns, from time to time. In order to limit the potential impacts of wildfire on personnel and assets, a Bush Fire Preparedness checklist is attached as Attachment 1. This checklist should be completed by WNR by October 1 of each calendar year and works to prepare the site undertaken during October to ensure readiness for the fire season.


The Bushfire Preparedness checklist also includes actions to be considered during a bushfire emergency situation.

## Fire Weather Monitoring


During the designated fire permit period (generally October 01 to March 30), site staff will monitor the Fire Danger Rating and Current Bushfires and Other Incidents on a regular basis (<http://www.fire.tas.gov.au/Show?pageId=colHome>).

If the Fire Danger Rating for the site is High or above, works on site shall be restricted including no hot works, no vegetation slashing or vehicle access off formed gravel roads.

**The Australian Fire Danger Ratings (AFDRS) levels are:**

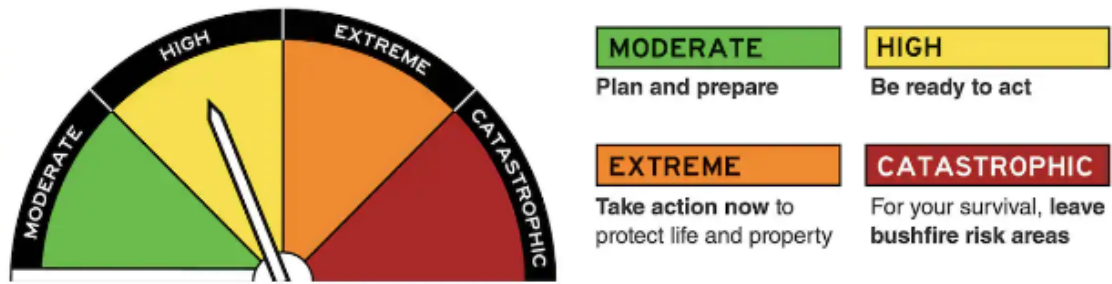

**Fire Behaviour Index (FBI)**

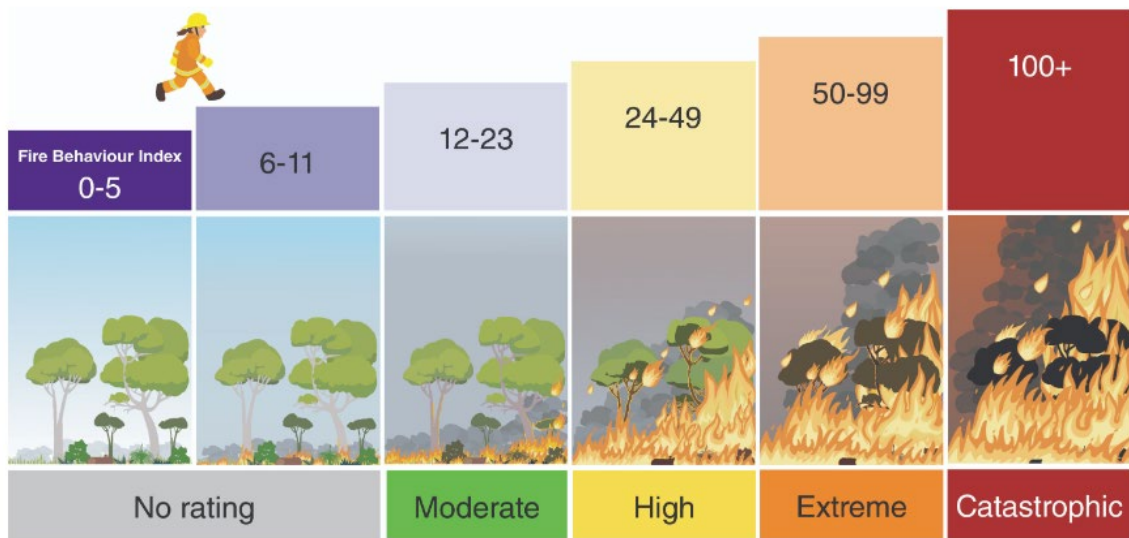

If a bushfire or incident is identified in the local or immediate vicinity of the site, the Incident Controller will follow the details included in this plan under the heading Offsite Emergencies.

**Site Roles and Responsibilities**

The wind farm (Figure 2) and transmission line (Figure 3) are owned and operated by WNR, including the balance of plant equipment. From an operational and practical perspective WNR has a designated Site Supervisor that oversees the staff and contractor activities on these plant. It would be anticipated that in the event of an emergency situation that the WNR Site Supervisor, or if not present, one of the secondary Supervisors, would coordinate the necessary emergency response as the Incident Controller.

## Site Description

The wind farm site consists of offices, tea room, toilets, workshop and garage area, switch room, switchyard, 36 V66 Vestas wind turbines, 17 km of internal gravel roads, viewing platform, storage shed, chemical storage facilities, fences and other farm infrastructure, a 22KV underground cable network, 2 km of the 110kv transmission line and a 22kv distribution line as a support and an emergency power feed (see Figure 2).

Each wind turbine holds approximately 500L of gearbox oil, as well as lubricating greases, coolant, hydraulic oil (ca. 300L), nitrogen gas, SF6 gas (in the RMU at the base of the turbine only). The switchyard contains a transformer containing 25,000 L of transformer oil. The main switchyard circuit breakers contain a small volume of SF6.

The wind farm property (1500 HA) is located within an agricultural landscape that contains consolidated stands of mature native vegetation. The neighbouring land is made up of similar proportions of pasture and native forest and scrub. The wind farm is located at TSMAP: Studland 3048 1:25000, or Easting 305500 Northing 5489882.

## Site Communication Equipment

All technicians on site have either mobile phones or UHF radios. All mobile phone numbers are available at the Attendance Registration System at the front door of the control building. Farm staff are only contactable via their supervisors (see contacts list). At the front gate to the site there is also an intercom system that allows contact with the Site Supervisor/Team Leader who can open the gate remotely.

## Site Security Systems

The only intruder alarm on the property is in the control building. The control box for the system is on the RHS wall as entering the front door of the building. To activate the system, wait for the "Ready" prompt and press the "Away" button. To deactivate the system, press the "Off" button then type in the four digit pass code. The phone number for the security company managing the system (Mekina Security) is 1300 300 438.

# General Attendance Requirements

## Requirements of All Workers

- All Workers (visitor requirements specified separately) must have completed the necessary inductions, for most persons this will include the corporate induction and site induction.
- All visitors to site must be accompanied at all times (by an inducted Worker) and visitors must not perform any work activities.
- It is the responsibility of all wind farm Workers to ensure that any visitors under their control and direction are briefed and understand the evacuation procedure.
- All Workers including visitors must utilise the site Attendance Registration System. This must be conducted immediately upon entry to the wind farm site, unless an emergency situation has been identified. The only exception to this is the licensee's farm staff which do not sign in at the attendance board and manage their own emergency response protocols.
- All site rules and signs must be obeyed, and all verbal directions given by the Site Supervisor are to be strictly followed.

## Wind Farm Attendance Registration System (ARS)

### *Purpose*

The ARS is designed to enable all persons in attendance at the Wind Farm to be accounted for in an emergency situation.

### *Entering the Wind Farm:*

Upon entering the wind farm site, all persons shall proceed directly to the site Control Building and sign into the ARS.

### *Leaving a Wind Farm:*

Before leaving the wind farm site, all personnel must sign out.

### *Emergency situation:*

In an emergency situation that requires the evacuation of the Wind Farm or associated assets, an Incident Controller has the responsibility to access the ARS at the entrance to the Control Building, to determine the personnel on site. The Incident Controller will check off people to ensure complete evacuation. If Workers are unaccounted for, attempts to contact and retrieve these people will be made as a matter of priority if safe and practical to do so.

## Chemical Information

### Oil and fuel

Oil is located in the following equipment:

Location	Oil Type	Volume (L) (max)
Switchyard transformer	Transformer oil	25 000
Station services transformer	Transformer oil	500
Turbine gear box	Gear oil	400
Turbine hydraulic system	Hydraulic oil	300
Oil Store	Gear, hydraulic, transformer, general. Includes waste oil	1000

### Gas

A number of large (g-size) gas bottles are stored at the control building in a designated cage, as well as flammable gasses at the large white shed (BPWF store - located 1km east of the Control building). Gases commonly stored on site include nitrogen and LPG and less frequently oxyacetylene and oxygen.

Gas filled equipment is also present in the wind turbine including nitrogen filled accumulators in the hub area and SF6 filled circuit breakers in the ring main unit located at the base of each wind turbine tower. The main switchyard circuit breaker (A152) is also SF6 filled, and an LPG fuelled forklift is housed in the BPWF store.

### Hazardous chemicals

All hazardous chemicals are either stored in the flammable goods cabinet in the garage of the control building, a chemical storage cabinet in the large white shed, in a bunded freight container next to the large white shed and the oil store near the BPWF store. A chemical storage points map is provided as an attachment to this manual as well as at the primary emergency meeting/muster point for the wind farm in a PVC tube.

## Site Emergency Equipment

The following emergency equipment is located on site.

<b>Equipment type</b>	<b>Location</b>	<b>Remarks</b>
First aid kits	Control building, all site vehicles	Fixed wall mounted kit in control building, mobile kits in control building and designated vehicles
Eye wash station	Control building, workshop & store room	Blue wall mounted station
Defibrillator	Control Building	Wall mounted in control building outside lunch/crib room door
Fire extinguisher – dry powder	Control Building (various locations), Oil store, every wind turbine nacelle base, site vehicles	Identified by standard signs
Fire extinguisher – CO2	Control Building and Switch room	Identified by standard signs, for use on electrical fires
Low Voltage Rescue Kit	Located in control building workshop cabinet	For rescue of personnel in low voltage (1000v) emergency situations.
Wind tower rescue kit	Located in nacelle of each wind turbine. Spare kit located in control building workshop cabinet	For rescue of incapacitated persons from tower ladder
Wind tower evacuation kit	Located in nacelle of each wind turbine. Spare kit located in control building workshop cabinet	For emergency evacuation of wind turbine
Hub rescue	Located at SBWF (full kit), BPWF stretcher only	For retrieval of injured personnel from wind turbine hub
Confined space rescue kit, including tripod	Located at SBWF only	For retrieval or injured personnel from confined spaces
Oil/Hydrocarbon spill kit – wheelie bin kit, portable kit	Located in control building workshop area, oil store, white shed	For clean-up and containment of fuel, chemical and oil spills
SF6 (sulphur hexafluoride) spill kit	Located in control building workshop area	For clean-up of SF6 spills and contaminated equipment
Dead Bird/bat recovery kit	Control building entrance cupboard	For collection and storage of dead birds or bats

Eagle recovery kit	Mezzanine floor of control building garage	For collection of injured eagles.
Portable water extinguisher	Located in control building sign in/entry area	For bushfire suppression
Portable radios & designated network	Located in control building and carried during work	Emergency communication devices. Carried during access to wind turbines. Site and cross site coverage. Cannot be used with emergency services.
Vehicle recovery kits	Located in some site vehicles	For use to extract bogged vehicles
Emergency information	Control building /muster locations.	Contains maps, site contacts, critical response information

## Bluff Point Wind Farm Contacts

WOOLNORTH WIND FARMS EMERGENCY CONTACT LIST		
<b>Adam Mullins</b>	Site Supervisor	<b>0428 388 370</b>
<b>Jason Jolly</b>	Wind Farm Technician Team Leader	<b>0427 519 507</b>
<b>Dylan Nicholls</b>	Wind Farm Technician Team Leader	<b>0408 242 454</b>
<b>Ashley House</b>	Maintenance Planner	<b>0427 486 177</b>
<b>Peter Clark</b>	Head of Operations	<b>0456 753 154</b>
<b>Chris Sims</b>	HSE Manager	<b>0428 347 942</b>
<b>Robert Barbour</b>	HSE Advisor	<b>0407 835 261</b>
<b>Alistair Mason</b>	HSE Support Officer	<b>0475 867 919</b>
EMERGENCY SERVICES		
<b>Fire, Police and Ambulance</b>		<b>000</b>
<b>Mekina Security</b>		<b>1300 300 438</b>
<b>Smithton Medical Centre</b>		<b>03 6452 2555</b>
<b>Police – non emergency</b>		<b>131 444</b>
<b>Poisons Information Centre</b>		<b>131 126</b>
<b>SES</b>		<b>132 500</b>
<b>Montague Fire Brigade</b>		<b>0419 521 399</b>
TAS NETWORKS		
<b>Operations Control Room</b>		<b>03 6274 3705</b>
Farm Staff CONTACTS		
<b>Gary Hite</b>	Farm Operations Manager	<b>0400 237 852</b>
WOOLNORTH TOURS		
<b>Laura McIntosh</b>	Tour operator for site	<b>0408 575 246</b>

# What to do in an Emergency

## Onsite Emergencies

### Identification of an Emergency

Everyone on site is authorised and has a duty to raise the alarm in the case of an emergency, either by contacting a Site Supervisor or Emergency Services (**by dialling 000**). An alarm may also be automatically initiated if systems detect a fire in the control building or a fault error may appear on various displays should an issue arise in a wind turbine or any of the electrical control equipment located in the switch room or switchyard. The latter alarms do not trigger an audible alarm.

### Controlling Events or Local Evacuation

If there are opportunities to control the escalation of an emergency to ensure no further risk or harm, steps should be taken to do this. HOWEVER, this is only to be attempted if it can be done without harm to yourself or others. If immediate action cannot be undertaken safely to prevent escalation, then the local area needs to be evacuated and all those that could immediately be affected should be contacted (e.g. personnel in the local area or immediate vicinity). Workers (including other site personnel) will congregate to an area that is a safe distance from the emergency situation and wait for further advice from the Incident Controller or Emergency Services. If necessary, an Incident Controller may decide a site-wide evacuation may be required and this should be to a designated site emergency meeting point.

### Reporting an Emergency

It is highly important that the communication of an emergency is conducted promptly and accurately. Communication should be conducted directly with an Incident Controller for the site (such as Site Supervisor) or Emergency Services (by dialling 000). Depending on the severity and escalation potential of the incident, it is preferred that a Site Supervisor is called rather than Emergency Services, but this decision will be made, without scrutiny or criticism, by the Worker identifying the emergency.

It is useful to relay the following information during the notification of an emergency:

1. date
2. time
3. name of caller
4. exact location of caller
5. exact location of the event
6. full description of event or warning
7. the caller's (your) contact phone number and or alternative means of communication.

If Emergency Services are contacted (by dialling 000) it is essential to follow their instructions (where safe to do so), provide information that is as accurate, clear, and concise as possible, and remain on the line until they no longer require you to do so.

Try and keep the device used (e.g. mobile phone) to contact emergency services in close proximity and within reception should emergency service need to contact you again.

### **Evacuation Procedure**

The type of emergency situation will affect the nature of an evacuation. Large bushfires threatening the entire site, for example, may require an entire site evacuation, in which case the Incident Controller will define the Muster Point. A fire in one of the control building rooms, however, would only require evacuation to the Muster Point outside the control building. All evacuations should be conducted in a safe, calm and controlled manner, following the requirements of the Incident Controller.

### **Emergency Management - Incident Controller**

The Site Supervisor, or if not present, the person with the most experience with the site conditions and emergency response planning, should take charge and must ensure appropriate steps are taken to implement this plan and manage the emergency (i.e. act as the Incident Controller). The control and coordination of an emergency situation may be handed over to a more competent Worker if they become available. If emergency services have been called then the emergency services may assume control on arrival, with the wind farm's Incident Controller providing assistance as necessary. The nature of these delegations will depend on the nature of the emergency and relevant competencies of the people responding to the incident. The Incident Controller is responsible for making sure the actions in this plan occur by delegating and coordinating tasks to the appropriate people on- and off-site, rather than by attempting to implement and control the emergency event on their own. All Workers are expected to assist in an emergency situation to the extent they are competent and experienced, and it is safe to do so.

Upon the identification or communication of an Emergency, a Worker is expected to make a judgment on the situation, validate the communication if necessary, determine the severity of the incident, and proceed with the appropriate responses. The following responses should be considered (see pg. 3):

1. If safe to do so, attempt to control or limit the extent of damage or injury and stabilise the situation.
2. Ensure the safe evacuation of all people on site, which must include the accounting of all personnel following the evacuation.
3. Communicate with the Emergency Services and the site Incident Controller (see pg. 3 for delegation priority list).
4. The Incident Controller is to assess the severity of the event, the specific risks that currently exist and that could develop and coordinate the emergency response.
5. Managing the event may include continuation of the evacuation including accounting for all personnel, communication with emergency services, delegation and coordination of the response, continued stabilisation of the situation (e.g. first aid, spill response, relocating flammable material).

6. On arrival of Emergency Services, the Incident Controller should provide advice to those services on the emergency situation and any other information relevant to the emergency and/or the site.
7. That attempts to prevent any environmental incident (e.g. oil spill, multiple bird collision event) from developing/spreading further are taken. This could include closing down of plant.
8. Keep a formal log of events associated with the emergency including communications, decisions made, and incidents reported. This task should not however be prioritised over control and coordination of the emergency situation.

### **Control Point**

The control point for managing an emergency and liaising with Emergency Services will normally be the Control Building. In the event of an emergency that results in this location being considered unsafe, the control point may be relocated by the Incident Controller, such as at the muster point. Where possible the control point should have access to communications equipment such as telephones, radio and computers. A temporary control point may be set up at the point of a localised emergency if deemed necessary by the Incident Controller. Personnel involved in the emergency should be made aware of where the control point is situated.

### **Wind Farm Operational Requirements**

In an Emergency, there are no specific requirements for the operation of the wind farm, i.e. the wind farm is simply left running as normal. This is the default position, however, if there is a specific risk to personnel or infrastructure by leaving the wind farm operating during an emergency then the necessary steps to reduce this risk must be taken. This decision will be made by the Incident Controller on a case-by-case basis.

### **Offsite Emergencies**

A number of emergency situations that initiate off the wind farm site may pose a significant risk to wind farm personnel or assets, particularly in the case of bush fires. Because of the facilities available, the wind farm may also be used as a control point for the management of off-site emergencies (e.g. helicopter extraction or communication points), such as vehicle/farm machinery accidents, flooding, and incidents within inaccessible neighbouring locations (e.g. offshore islands). If a bushfire is identified by a Worker in a neighbouring property, they shall ensure this is communicated to site personnel and, if required, request a site wide evacuation to a designated safe point (e.g. site muster point). An Incident Controller will monitor the fire situation by listening to ABC Local radio (91.3 FM or online [www.abc.net.au](http://www.abc.net.au)) and by monitoring the Tasmanian Fire Service web site (Current bushfires and other incidents page [www.fire.tas.gov.au](http://www.fire.tas.gov.au)). Detailed advice on the situation shall be provided by the Incident Controller ensuring, to the greatest extent possible, site personnel are aware of the situation and act accordingly.

## Potential Emergency Events at BPWF

Event Type	Location/Examples	Compounding Site Factors	Key Emergency Response Steps (see page 3 for all initial response steps)
Fire/Explosion	Forest/scrub/pasture	Entrapment risk due to single egress routes from some circuits	<ul style="list-style-type: none"> <li>• Local or site evacuation or shelter in safe zone (e.g. turbine base)</li> <li>• Communicate with and assist Emergency Services and Incident Controller</li> </ul>
	Assets (Control Building, Substation/Switchyard, Sheds)	Nil	<ul style="list-style-type: none"> <li>• Local or site evacuation</li> <li>• Communicate with and assist Emergency Services and Incident Controller</li> </ul>
	Turbine	Nil	<ul style="list-style-type: none"> <li>• Local or site evacuation</li> <li>• Communicate with Incident Control and assist Emergency Services</li> </ul>
Serious Harm Incident	Electrocutions, Falling From Heights, Vehicle Accident	Remoteness, Industrial Complications	<ul style="list-style-type: none"> <li>• Make incident site safe or cordon-off</li> <li>• Apply first aid</li> <li>• Communication with Incident Controller</li> <li>• Assist Emergency Services with treatment and extraction of patient/s</li> </ul>
Serious Operational Incident	Storm Event, Catastrophic Turbine Failure, Crane Collapse	Remoteness, Limited Site Resources	<ul style="list-style-type: none"> <li>• Local evacuation and incident site management e.g. minimise further asset damage and controlling of access</li> </ul>
Environmental Incident	Oil/Fuel Spill, Multiple Bird Collision Event	Remoteness, Limited Site Resources	<ul style="list-style-type: none"> <li>• Containment and harm minimisation steps</li> <li>• Close down any relevant plant and make site safe</li> <li>• Record details and observations</li> </ul>

## **Communication and Review**

The plan will be annually discussed and reviewed by site personnel at a toolbox meeting (November is suggested) or other meeting convened separately. The objectives of the discussion will be to ensure all site Workers are aware of the plan and what steps are required in an emergency situation.

The plan is to be reviewed by WNR on an annual basis and updated as required.

## Attachment 1 – Bushfire Preparedness Checklist

<b>AROUND BUILDING PREPARATIONS</b>	
	Any shrubs and small trees around buildings (20m) selectively removed
	All grass out to 35m slashed low and maintained throughout the fire permit period
	Rubbish heaps and other fuels removed to a safe distance (none within 25m)
	All vegetation under trees removed to a height of at least 2 metres
	Roof and gutters cleared of leaf debris
	Dry leaves and bark removed from lawns and gardens in the inner and outer zone
	Vents into roof spaces screened with fine wire mesh
	Gaps in external roof and wall cladding sealed
<b>WATER SUPPLIES AND FIREFIGHTING EQUIPMENT PREPARATIONS</b>	
	Fire fighting water supply available (reticulated or min. 20,000 litres static supply) fitted with 50mm outlet with BSP male thread fitted with a 65mm STORZ adaptor as per Tasmania Fire Service specifications (installed on the storage tank), or the tank will have a suitable opening (minimum 250mm in diameter) in the top of the tank
	Buckets, mop, rake available, standard garden hose, internal tap fitting for garden hose
	Ladder, torch available
	Battery operated radio available
	Check designated farm water supply points and ensure access is adequate.
<b>PREPARATION AROUND FARM</b>	
	Check turbines in vegetated areas of C&D circuit and ensure vegetation in the previously cleared areas is not greater than 250mm
	Check 2 fire breaks in C&D circuit and ensure they could be used by all site vehicles
<b>PREPARATIONS WHEN FIRE BREAKS OUT, IF STAYING AT DESIGNATED SAFE AREA</b>	
	Prepare fire pump and attach hoses
	Remove or move any outdoor equipment away from building e.g. 20m.
	Check roof and gutters for leaf debris and clear
	Plug all down pipes (using sock filled with sand/soil), and fill gutters with water
	Fill baths, sinks and buckets with water
	Remove dry leaves and bark from nearby if time
	Close all doors, windows and window shutters

	Ensure site personnel are safe and accounted for
	Place wet towels and blankets against gaps under doors and windows
	Ensure appropriate PPE is available
	Monitor ABC local radio on 91.3 FM or online <a href="http://www.abc.net.au/hobart/programs/webcam_radio.htm?ref=listenliveradio">http://www.abc.net.au/hobart/programs/webcam_radio.htm?ref=listenliveradio</a> or access <a href="http://www.fire.tas.gov.au">www.fire.tas.gov.au</a>
<b>IF LEAVING BEFORE THE FIRE ARRIVES</b>	
	Only if safe to do so
<b>WHEN THE FIRE ARRIVES</b>	
	Extinguish sparks, embers and spot fires close to buildings if safe to do so
	When too hot to stay outside, go into the house to protect yourself from radiant heat
	Take firefighting equipment, ladder, hose and fittings inside
	Connect hose to laundry tap
	Frequently check inside the house and in the roof cavity (using the ladder) for any fires – turn power off if extinguishing near electrical wiring (therefore may need alternative generator power supply for building pump)
	Extinguish any fires that break out inside
<b>AFTER THE FIRE HAS PASSED</b>	
	Go outside as soon as possible and use water to extinguish any fires posing an immediate threat to your home
	Patrol your property for several hours and douse any embers that land on or near your home
	Check the roof cavity frequently from inside your home for any fires
	Drink water frequently to avoid dehydration
	Help your neighbours if possible